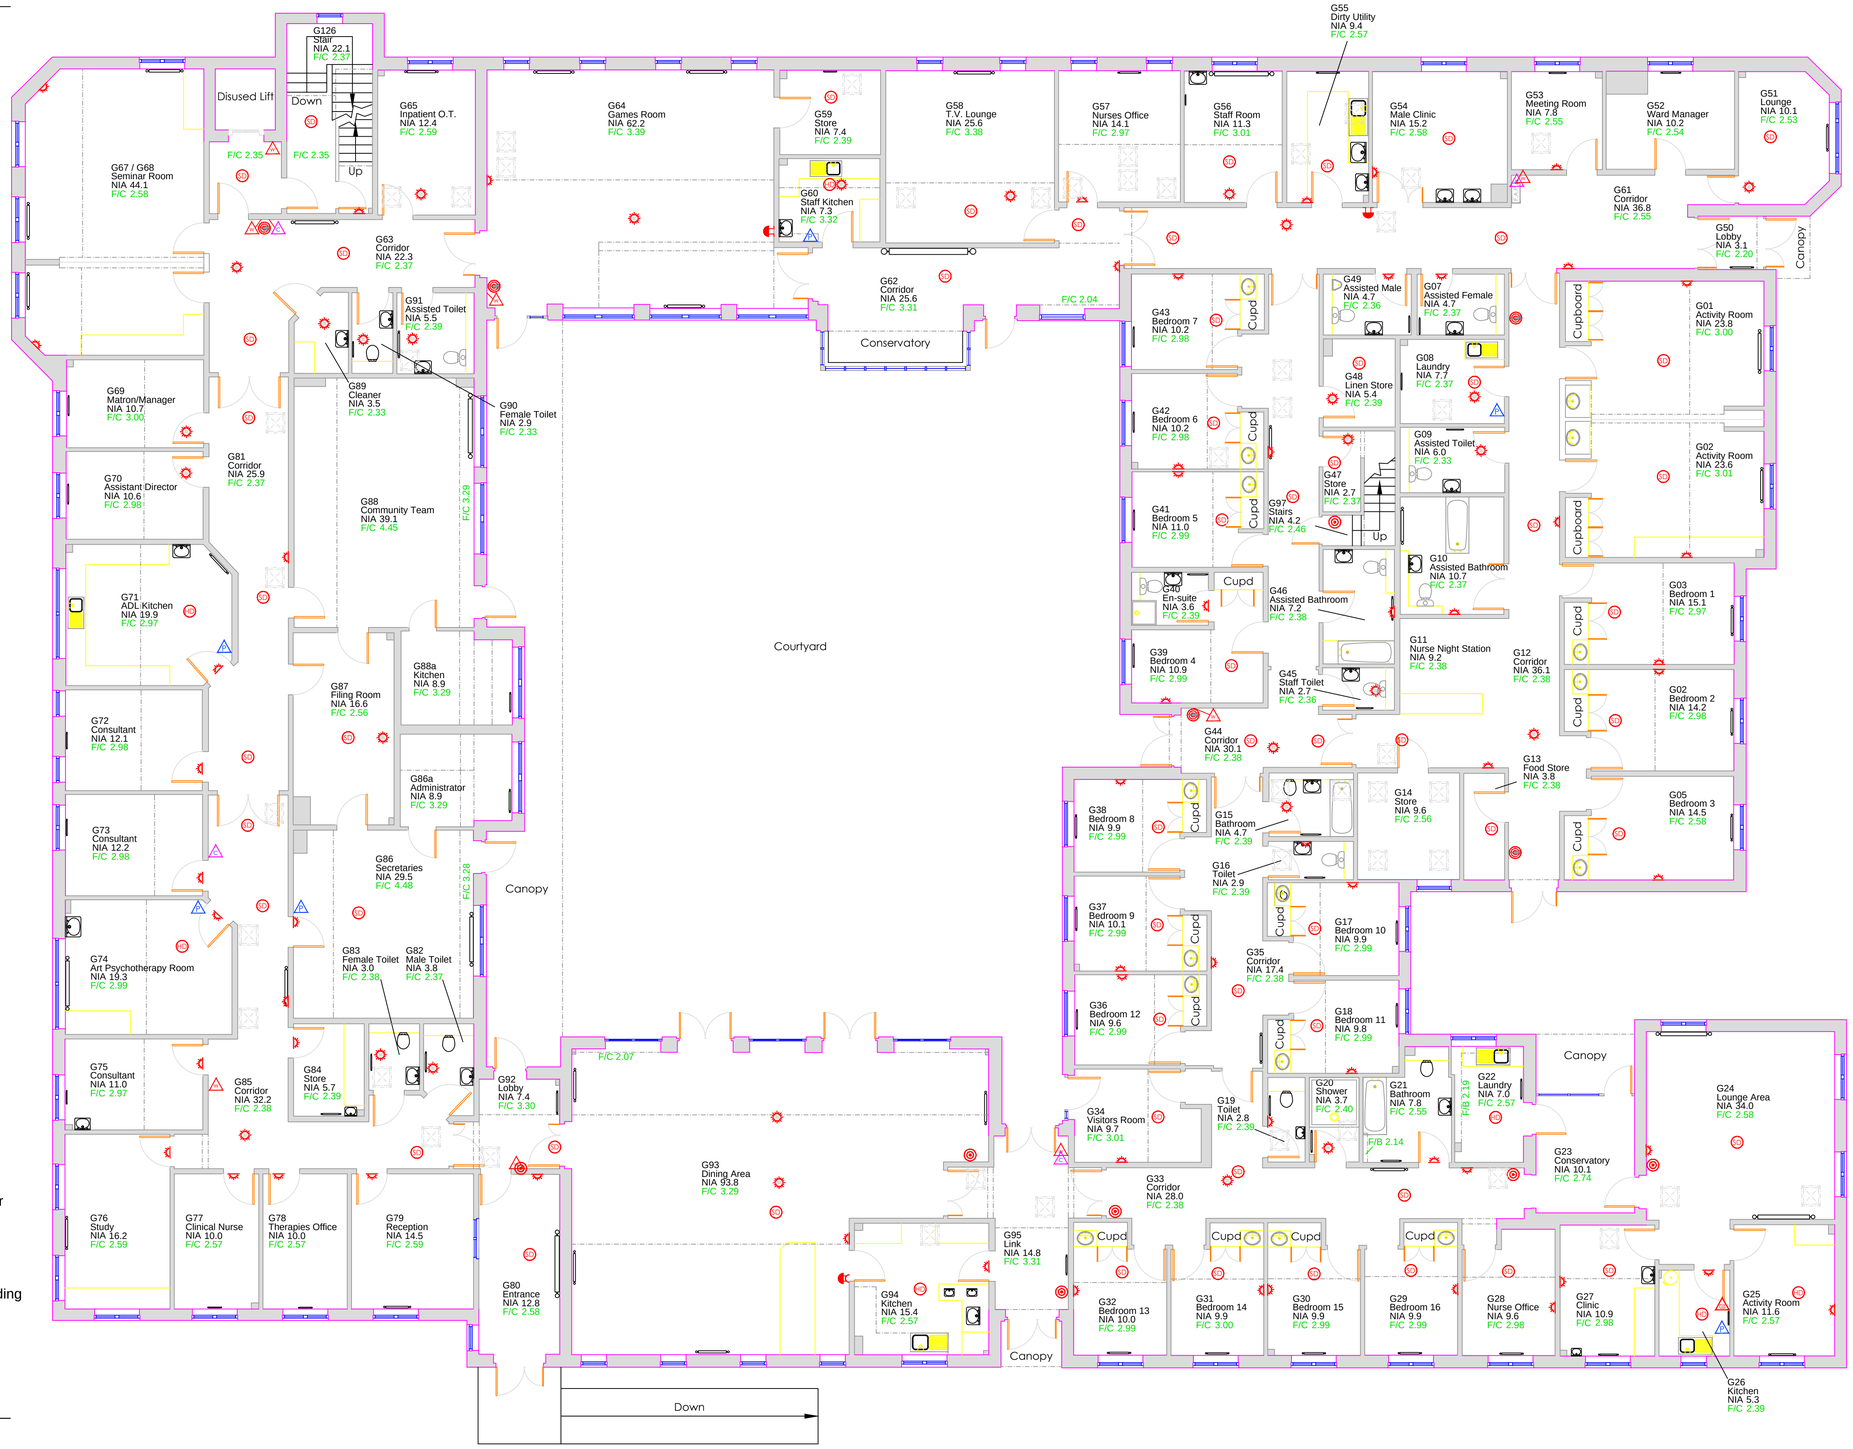

Ground Floor
1573.9
1460.9
1355.0
Sample Unit
Sample Building

Sample Unit
2215.2
2065.1
1923.3
Sample Building

2 0 10 metres
SCALE BAR

Notes

SYMBOLS

- Fire Alarm Call Point [Break Glass]
- Fire Alarm Call Point [Break Glass Covered]
- Fire Alarm Call Point [Key Operated]
- Smoke Detector
- Smoke Detector [Caged]
- Smoke Detector [Ceiling Void]
- Heat Detector
- Heat Detector [Caged]
- Heat Detector [Ceiling Void]
- Flame Detector
- Gas Detector
- Beam Detector
- Audible Warning Device [Loudspeaker]
- Audible Warning Device [Fire Alarm]
- Sounder [Wall Mounted]
- Visual Warning Device with Sounder [Wall Mounted]
- Visual Warning Device [Ceiling Mounted]
- Visual Warning Device [Wall Mounted]
- Fire Blanket
- Fire Extinguisher [Standard CO2]
- Fire Extinguisher [Standard Dry Powder]
- Fire Extinguisher [Standard Foam]
- Fire Extinguisher [Standard Halon Gas]
- Fire Extinguisher [Standard Water]
- Hosereel 45m Long
- Sprinkler Head
- Fire Alarm Panel
- Firemans Override Switch
- Explosive Material Risk Area
- Flammable Material Risk Area
- General Hazard Warning [CB]
- General Hazard Warning
- Oxidising Material Risk Area
- Automatic Door Release
- Maglock with Automatic Release
- Storage Heater
- Boiler
- CCTV Camera
- CCTV Monitor
- Hatch
- Consumer Unit
- Cooker Control Unit
- Door
- Radiator
- Bath Unit
- Sluice
- Cleaners Bucket Sink
- Shower Tray
- Corner Shower Tray
- Kitchen Sink
- Toilet
- Urinal
- Wash Hand Basin P1
- Corner Wash Hand Basin
- Bedroom Wash Hand Basin
- Wash Hand Basin (Built in Vanity Unit)
- Riser
- Ceiling
- Skylight

SAMPLE

Rev	Date	Drawn	Description	Ch'k'd	App'd
0	19.11.08		Original Drawing		

N D Oliver & Co Ltd
Ptolemy House
7 School Road
Sale
Manchester M33 7XY

Telephone 0161 973 3495
Facsimile 0161 962 6819
E-mail: mail@ndoliver.com

Client

CLIENT NAME
ADDRESS
TOWN
CITY
POSTCODE

Title

SAMPLE HOSPITAL FLOOR PLAN

Surveyed	GB		Drawn	KD	
Dwg.Chk.	AWP		Approved	NDO	
Scale 1:100 @ A1	Project 1234				Status ORIG
	CAD file \PROJECTS\SAMPLES\DRAWINGS				
Drawing No N1234 / 56789-10 / 001					Rev 0